

# Cridersville Fire Department


Cridersville, OH

This report was generated on 8/12/2024 6:52:31 PM



## Incident Type Count per Zone for Date Range

Start Date: 07/01/2024 | End Date: 07/31/2024

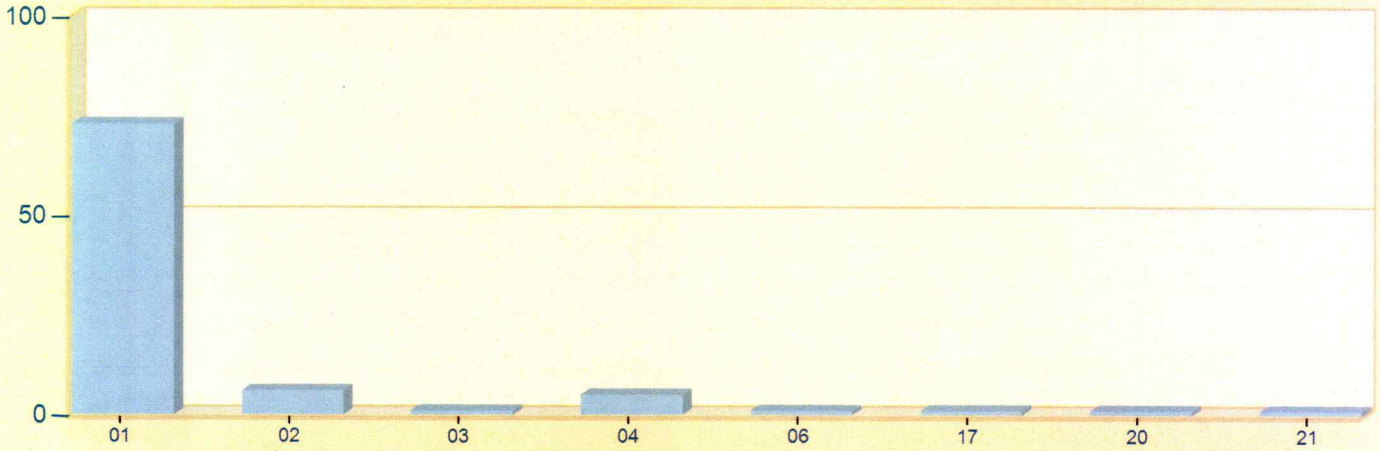

ZONES	INCIDENT TYPE	COUNT
<b>01 - Cridersville</b>		
	113 - Cooking fire, confined to container	1
	321 - EMS call, excluding vehicle accident with injury	65
	412 - Gas leak (natural gas or LPG)	1
	611 - Dispatched & cancelled en route	1
	741 - Sprinkler activation, no fire - unintentional	2
	743 - Smoke detector activation, no fire - unintentional	1
	744 - Detector activation, no fire - unintentional	2
	<i>Total Incidents for 01 - Cridersville:</i>	73
<b>02 - Duchouquet Twp</b>		
	321 - EMS call, excluding vehicle accident with injury	4
	500 - Service Call, other	1
	744 - Detector activation, no fire - unintentional	1
	<i>Total Incidents for 02 - Duchouquet Twp:</i>	6
<b>03 - Buckland</b>		
	321 - EMS call, excluding vehicle accident with injury	1
	<i>Total Incidents for 03 - Buckland:</i>	1
<b>04 - Logan Twp.</b>		
	321 - EMS call, excluding vehicle accident with injury	4
	611 - Dispatched & cancelled en route	1
	<i>Total Incidents for 04 - Logan Twp.:</i>	5

Zone information is defined on the Basic Info 3 screen of an incident.  
Only REVIEWED incidents included.



ZONES	INCIDENT TYPE	COUNT
<b>06 - Wapakoneta</b>		
	321 - EMS call, excluding vehicle accident with injury	1
	<i>Total Incidents for 06 - Wapakoneta:</i>	<i>1</i>
<b>17 - Spencerville</b>		
	111 - Building fire	1
	<i>Total Incidents for 17 - Spencerville:</i>	<i>1</i>
<b>20 - Bath TWP.</b>		
	150 - Outside rubbish fire, other	1
	<i>Total Incidents for 20 - Bath TWP.:</i>	<i>1</i>
<b>21 - Auglaize Twp.(Harrod)</b>		
	111 - Building fire	1
	<i>Total Incidents for 21 - Auglaize Twp.(Harrod):</i>	<i>1</i>
<b>Total Count for all Zone:</b>		<b>89</b>

Zone information is defined on the Basic Info 3 screen of an incident.  
Only REVIEWED incidents included.

